

4147 Everywhere Texture was tested and met the following flammability requirements:

ASTM E 84 Unadhered Class A
CA TB 117-2013
UL Listed



Received:08/02/2017	Completed:08/04/2017	Letter: N1	RM	P.O.#:	Test Report #:	3-20494-1-
Client's Identification	Style: 4147 Everywhere Content: 100% Polyester. Color: Light Blue. Product End Use: Upholstery Panel. Texture					
Tested For: Megan Rietzke Designtex 200 Varick Street, 8 fl. New York, NY 10014			Key Test: ASTM E 84/ACT Tel: 1-(212)-886-8137 Fax: 1-()- -			1275 Ext:

Test Category: Tunnel Test Specifier: ACT NTR 8/15 LE 2015; V 08/15
PC: ME dl/SM

TEST PERFORMED: ASTM E 84 - Standard Test Method for Surface Burning Characteristics of Building Materials * --

As cited by the ACT Voluntary Performance Guidelines (January 2015)

APPROXIMATE THICKNESS OF SPECIMEN (as measured by Govmark): 0.036"

PRODUCT CATEGORY:

- ☐ Direct Glue Wallcoverings
☒ Wrapped Panels & Upholstered Walls
☐ Other Products: _____

* NOTE: Textile or expanded vinyl wallcoverings classified by this procedure are limited to use in sprinklered areas in certain public occupancies. If textile or expanded vinyl wallcoverings are used in non-sprinklered areas, the NFPA 265 corner fire test is mandated.

For other interior finish products in non-sprinklered areas, a room corner fire test also applies. This would be NFPA 286.

SPECIMEN MOUNTING:

- ☐ Self Supporting: The test specimen, the face of which was 23" \pm 1" x 24', was such that it remained in position in the tunnel during the fire test, and no additional support was required.
- ☐ Adhered to IRC: The test specimen was bonded to three 1/4" IRC (Inorganic Reinforced Cement) boards (a cement asbestos substitute) to form a test specimen the face of which was 23" \pm 1" x 24'.
- ☐ Adhered to Gypsum: The test specimen was adhered to 5/8" thick Type X gypsum board, to form a test specimen the face of which was 23" \pm 1" x 24'.
- ☒ Unadhered: The 23" \pm 1" x 24' specimen was not adhered to any substrate. Instead, it was laid over a 2" hexagonal wire mesh screen and 1/4" rods.
- ☐ Other: _____



96-D Allen Boulevard
Farmingdale, New York 11735-5626 USA
Tel. +1 (631) 293-8944 Fax +1 (631) 293-8956
e-mail: testing@govmark.com

Page 2

Received:08/02/2017	Completed:08/04/2017	Letter: N1	RM	P.O.#:	Test Report #:	3-20494-1-
Client's Identification	Style: Everything Plain. Content: 100% Polyester. Color: Light Blue. Product End Use: Upholstery Panel.					
Tested For: Megan Rietzke Designtex 200 Varick Street, 8 fl. New York, NY 10014			Key Test: ASTM E 84/ACT			1275
			Tel: 1-(212)-886-8137		Ext:	
			Fax: 1-()- -			

RESULTS:

Flame Spread Index: 0
Smoke Developed: 10

ACCEPTANCE CRITERIA:

	Flame Spread Index	Smoke Developed
Class A	0 - 25	450 or less

NOTE: Class A is also known as Class 1, and may be so specified in some Codes.

CONCLUSION: Based on the above Results and Acceptance Criteria the item tested:

☒ Complies; ☐ Does not comply

REMARKS: None

DATA SUMMARY:

Time to Ignition: 0 minutes
Maximum Flame Spread "Distance": 0 feet
Maximum Flame Spread "Time": 0 minutes

CERTIFICATION: I certify that the above results were obtained after testing specimens in accordance with the procedures and equipment specified above.




AUTHORIZED SIGNATURE
GOVMARK
/pm /mo

Phyllis Pettit
AUG 15 2017

(Page 2 of 2)

Test Method	: ASTM E84
Test Report #	: 3-20494-1-N1
Date	: 8/4/2017
Client	: Designtex
Operator	: Rick McDonough
Details of Preparation	: Unadhered. Specimen laid over 2" hexagonal wire mesh and 1/4" rods. One 16 foot long section and one 8 foot long section butted end to end
Observations	: No ignition. Material melted away. Heavy dripping.


Area Under Flame Curve (ft min)	: 0.01
Raw Flame Spread Index (ft min)	: 0.00
Rounded Flame Spread Index (ft min)	: 0
Ignition Time	: No Ignition
Area Under Smoke Curve (%A min)	: 5.51
Raw Smoke-Developed Index	: 7.82
Rounded Smoke-Developed Index	: 10
Total Gas Flow(L)	: 1401.7
Total Gas Flow(ft ³)	: 49.5
Maximum Flame Front Achieved(ft)	: 0 (@0s)

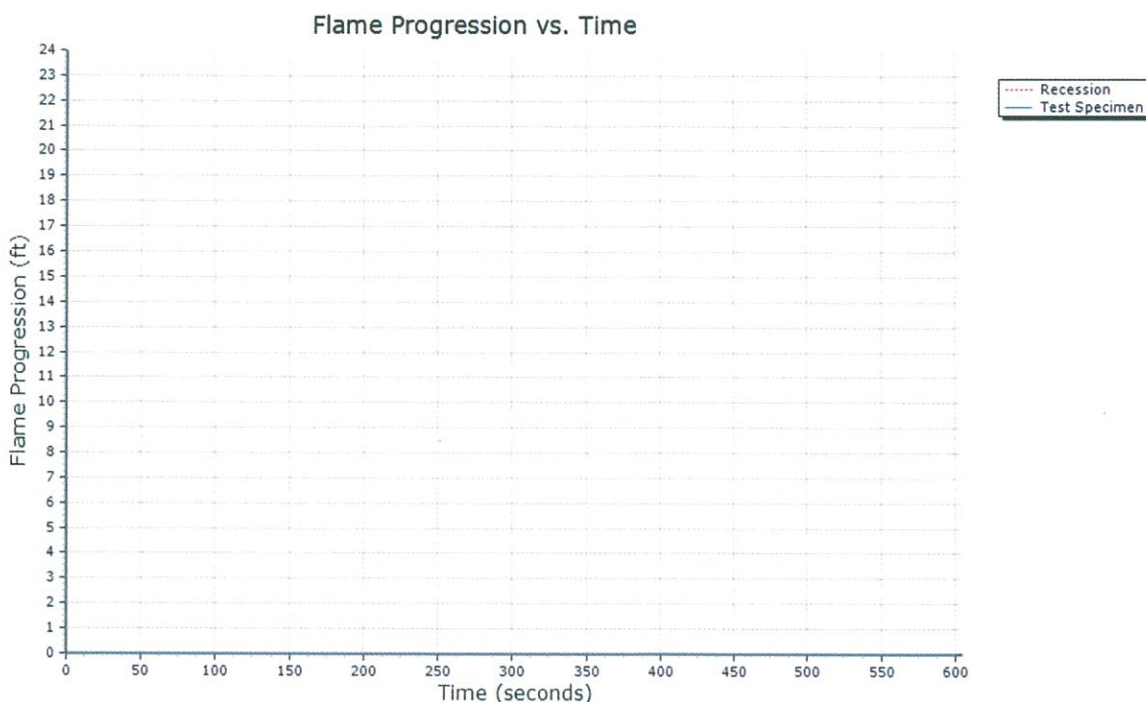



Program: ASTM E84 (Version 1.40)

Test Method : ASTM E84
Test Report # : 3-20494-1-N1

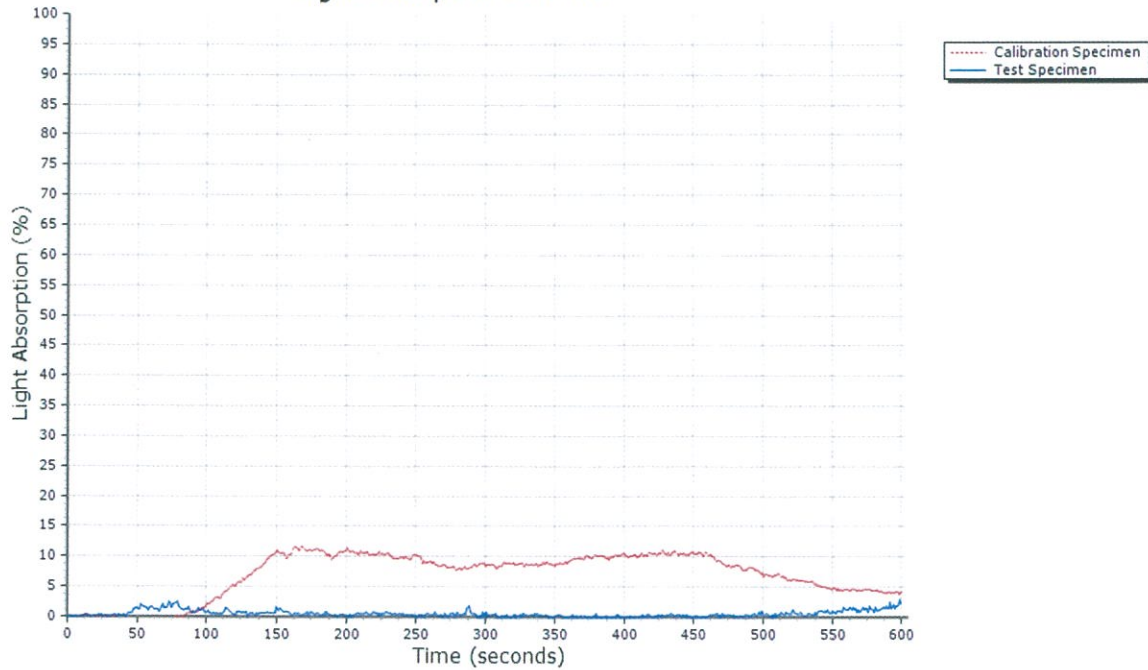Light Absorption vs. Time

ISO/IEC 17025 Third Party Test Report

DATE: September 22, 2021

FILE: DESTEX.A091521A

CLIENT: Designtex Product Services
357 County Ave
Secaucus, NJ 07094

ATTN: Teesha Prezeau

SAMPLE IDENTIFIED BY CLIENT AS:

Fabric Submitted
Name: Everywhere Texture 4147
Quality: 16.5 oz., lin yd 55"
100% Polyester
Color Gold

TEST PROCEDURE:

TEST RESULTS:

CALIFORNIA TECHNICAL BULLETIN 117-2013
SECTION 1 COVER FABRIC TEST

	<u>CHAR LENGTH (mm)</u>
Specimen #1:	20
Specimen #2:	22
Specimen #3:	21

- a) The mock-up test specimen continues to smolder after the 45-minute test duration: **NO**
b) A char develops more than 1.8 inches (45 mm) in any direction from the cigarette on the cover fabric measured from its nearest point: **NO**
c) The mock-up test specimen transitions to open flaming: **NO**

RESULTS: PASS

- A material is considered to pass or fail based on the following criteria:
1. A single mock-up test specimen fails to meet the requirements of this test procedure if any of the following criteria occurs:
 - a) The mock-up test specimen continues to smolder after the 45-minute test duration.
 - b) A char develops more than 1.8 inches (45 mm) in any direction from the cigarette on the cover fabric measured from its nearest point.
 - c) The mock-up test specimen transitions to open flaming.
 2. The cover fabric passes the test if three initial mock-up specimens pass the test, i.e., the cigarettes burn their full length and the mock-ups are no longer smoldering.
 3. If more than one initial specimen fails, the cover fabric fails the test.
 4. If any one of the three initial specimens fails, repeat the test on an additional three specimens.
 5. If all three additional specimens pass the test, the cover fabric passes the test. If any one of the three additional specimens fails, the cover fabric fails the test.

Signed For The Company By

Joseph Lin / ADV.
Joseph Lin
Laboratory Manager



Stacy Sadowy
Stacy Sadowy
Quality Assurance Manager

CS/09

